

QUICK GUIDE

Sigma 05 Sensor Hub/Modular Sensor Platform

Find this document and further product information on our website at www.epluse.com/sigma05.

General Information

Sigma 05 is a host device (Modbus master) for up to three E+E sensing probes / measurement devices with RS485 interface and Modbus RTU protocol.

This Quick Guide focuses on the Sigma 05 functionality with E+E plug-and-play probes. Please make sure to review the Sigma 05 user manual at www.epluse.com/sigma05 for manual setup and other Sigma 05 features.



Please note:

The Sigma 05 must be powered off while connecting or disconnecting probes.

Plug-and-Play Operation/Setup


With enabled automatic discovery function (default setting), Sigma 05 automatically recognizes E+E plug-and-play probes and their combinations according to the table below, see "Probe Combinations and Automatic Discovery". Furthermore, the assignment of the measurands to the outputs and display, as well as the scaling of the outputs is performed automatically according to the table. This setup can be changed subsequently by the user as required, see "Manual Operation/Setup" below.

Manual Operation/Setup

For manual setup connect Sigma 05 to a personal computer running PCS10 Product Configuration Software, free download from www.epluse.com/pcs10.

Disable the automatic discovery function and proceed with assigning measurands to the outputs and display as well as with the output scaling. See the user manual at www.epluse.com/sigma05.

Sensing Probe Connection (RS485 Interface with Modbus RTU Protocol)



M12 device socket front view

Pin number	Function
1	Supply voltage ^{*)}
2	B RS485 (D-)
3	GND
4	A RS485 (D+)

^{*)} The supply voltage at the probe connector is always equal to the supply voltage applied to Sigma 05.


Important: Choose the Sigma 05 supply voltage (in the range 15 - 30 V DC) to match the probe supply requirements.

Voltage Supply and Outputs



Important note:

The manufacturer cannot be held responsible for personal injuries or damage to property as a result of incorrect handling, installation, wiring, power supply and maintenance of the device.

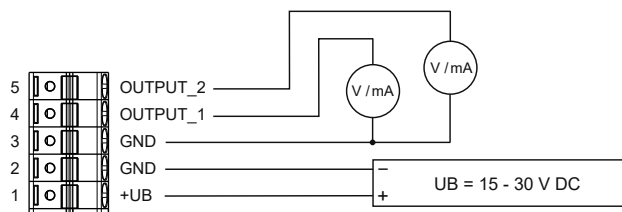

Modbus Setup

	Factory settings	Selectable values
Baudrate	9600	9600, 19200, 38400, 57600, 115200
Data bits	8	8
Parity	Even	None, even, odd
Stop bits	1	1, 2
Modbus Master	Sigma 05 has no Modbus ID	

The recommended settings for multiple devices in a Modbus RTU network are 9600, 8, Even, 1. The Sigma 05 represents 1 unit load in a Modbus network.

Probe Combinations and Automatic Discovery

#	Probe	Analogue Output 1			Analogue Output 2			Display Line 1			Display Line 2			Display Line 3		
		Measurand	Scale SI	Scale US	Measurand	Scale SI	Scale US	SI	US	SI	US	SI	US	SI	US	
1	EE072	RH	0...100%	0...100%	T	-40...80 °C	-40...176 °F	RH [%]	RH [%]	T [°C]	T [°F]					
2	EE074	T	-40...80 °C	-40...176 °F				T [°C]	T [°F]							
3	EE872-M13	CO ₂	Range of probe	Range of probe	RH	0...100 %	0...100 %	CO ₂ [ppm]	CO ₂ [ppm]	RH [%]	RH [%]	RH [%]	RH [%]	T [°C]	T [°F]	
4	EE872-M10	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
5	EE671	v	Range of probe	Range of probe				v [m/s]	v [ft/min]							
6	EE680	vn	Range of probe	Range of probe	T	0...50 °C	32...122 °F	vn [m/s]	vn [ft/min]	T [°C]	T [°F]					
7	HA010406	RH	0...100%	0...100%	T	-40...180 °C	-40...356 °F	RH [%]	RH [%]	T [°C]	T [°F]					
8	EE072	RH	0...100%	0...100%				RH [%]	RH [%]							
8	EE074				T	-40...80 °C	-40...176 °F			T [°C]	T [°F]					
9	EE872-M13	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
9	EE072				RH	0...100%	0...100%			RH [%]	RH [%]	RH [%]	RH [%]	T [°C]	T [°F]	
10	EE872-M10	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
10	EE072				RH	0...100%	0...100%			RH [%]	RH [%]	RH [%]	RH [%]	T [°C]	T [°F]	
11	EE671	v	Range of probe	Range of probe				v [m/s]	v [ft/min]							
11	EE072				RH	0...100%	0...100%			RH [%]	RH [%]	RH [%]	RH [%]	T [°C]	T [°F]	
12	EE680	v	Range of probe	Range of probe				vn [m/s]	vn [ft/min]							
12	EE072				RH	0...100%	0...100%			RH [%]	RH [%]	RH [%]	RH [%]	T [°C]	T [°F]	
13	EE872-M13	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
13	EE074				T	-40...80 °C	-40...176 °F			T [°C]	T [°F]					
14	EE872-M10	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
14	EE074				T	-40...80 °C	-40...176 °F			T [°C]	T [°F]					
15	EE671	v	Range of probe	Range of probe				v [m/s]	v [ft/min]							
15	EE074				T	-40...80 °C	-40...176 °F			T [°C]	T [°F]					
16	EE680	vn	Range of probe	Range of probe				vn [m/s]	vn [ft/min]							
16	EE074				T	-40...80 °C	-40...176 °F			T [°C]	T [°F]					
17	EE872-M13	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
17	EE671				v	Range of probe	Range of probe			v [m/s]	v [ft/min]			T [°C]	T [°F]	
18	EE872-M13	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
18	EE680				vn	Range of probe	Range of probe			vn [m/s]	vn [ft/min]					
19	EE872-M10	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
19	EE671				v	Range of probe	Range of probe			v [m/s]	v [ft/min]					
20	EE872-M10	CO ₂	Range of probe	Range of probe				CO ₂ [ppm]	CO ₂ [ppm]							
20	EE680				vn	Range of probe	Range of probe			vn [m/s]	vn [ft/min]			T [°C]	T [°F]	

Probe Combinations and Automatic Discovery

#	Probe	Analogue Output 1			Analogue Output 2			Display Line 1		Display Line 2		Display Line 3	
		Measurand	Scale SI	Scale US	Measurand	Scale SI	Scale US	SI	US	SI	US	SI	US
21	EE680 EE671	vn	Range of probe	Range of probe	v	Range of probe	Range of probe	vn [m/s]	vn [ft/min]			T [°C]	T [°F]
22	HTP501	RH	0...100%	0...100%	T	-40...120 °C	-40...248 °F	RH [%]	RH [%]	T [°C]	T [°F]		
23	HTP501 EE074	RH	0...100%	0...100%	T	-40...120 °C	-40...248 °F	RH [%]	RH [%]	T [°C]	T [°F]		
24	MOP301	aw	0...1	0...1	T	-40...120 °C	-40...248 °F	aw[-]	aw[-]	T [°C]	T [°F]		
25	MOP301 EE074	aw	0...1	0...1	T	-40...120 °C	-40...248 °F	aw[-]	aw[-]	T [°C]	T [°F]		



YOUR PARTNER IN SENSOR TECHNOLOGY

ELEKTRONIK[®]
Ges.m.b.H.

INFORMATION

+43 7235 605 0 / info@epluse.com

E+E Elektronik Ges.m.b.H.
Langwiesen 7 • 4209 Engerwitzdorf • Austria
Tel: +43 7235 605-0 • Fax: +43 7235 605-8
info@epluse.com • www.epluse.com

LG Linz Fn 165761 t • VAT No. ATU44043101
Place of Jurisdiction: 4020 Linz • DVR0962759

UK
CA

CE

